

## Multi-Channel Modular Type High Performance Temperature Controller

### ■ Feature

#### [Common]

- Easy maintenance with separated body/base parts
- No communication and power supply for expansion modules required using module connectors: Up to 32 modules
- PC parameter setting via PC (USB cable and RS485 communication): Supports comprehensive device management program (DAQMaster)
- ※ Communication converter, sold separately: SCM-US(USB/Serial converter), SCM-38I(RS232C/RS485 converter), SCM-US48I(USB/RS485 converter), SCM-WF48(Wi-Fi/RS485·USB wireless communication converter), EXT-US (converter cable)

#### [TMH2/4 Series (control module)]

- One module supports multi channels(2 channels/4 channels) for input/output control : connecting TMH2/4, up to 32 modules (2 channels: 64 channels/4 channels: 128 channels)
- High-speed sampling with 50ms and  $\pm 0.3\%$  measuring accuracy
- Simultaneous heating/cooling control and auto/manual control for high-performance control
- Selectable current output or SSR drive output
- Each channel insulated (dielectric strength 1,000VAC)
- ※CT input terminal for measuring load current (※CT, sold separately: CSTC-E80LN, CSTC-E200LN, CSTS-E80PP)
- Multi input/Multi range



#### [TMHA(analog input/output option module)]

- 4 channels, multi input/multi range/transmission output(DC0-20mA or 4-20mA)
- Each channel insulated (dielectric strength 1,000VAC)
- High-speed sampling with 50ms and  $\pm 0.3\%$  measuring accuracy

#### [TMHE(digital input/Alarm output option module )]

- Digital input (8 types)/Alarm output(8 types)

#### [TMHCT (CT input option module)]

- 8 CT inputs
- CT input status indicators

#### [TMHC (communication option module)]

- Connection expansion to master devices (PC, PLC, etc) with TMH2/4 (control module) and TMHA/E/CT (option module) (up to 16 modules)
- One module connects up to 32 control /option modules
- RS422 or RS485 communication



 Please read "Safety Considerations" in operation manual before using.



### ■ Manuals

- For the detail information and instructions, please refer to user manual and user manual for communication, and be sure to follow cautions written in the technical descriptions (catalog, homepage).

Visit our homepage ([www.autonics.com](http://www.autonics.com)) to download manuals.

- User manual describes for specifications and function, and communication manual describes for RS485 communication (protocol Modbus RTU) and parameter address map data.

# Multi-Channel Modular Type High Performance

## Ordering Information

### Control module

Item	TMH	2	-	4	2	R	B	
Module type							B	Basic module
							E	Expansion module※1
Control output						R		Relay output
						C		Selectable current or SSR drive output
Power supply					2			24VDC
Input/Output option	2CH	2	CT input, digital input (DI-1/2), alarm output 1/2, RS485 comm. output					
			CT input, digital input (DI-1/2), alarm output 1/2/3/4, RS485 comm. output					
		4CH	N	CT input, RS485 comm. output				
Channels	2	2 channels						
	4	4 channels						
Item	TMH	Advanced Multi-Channel Modular Temperature Controller						

※1: Since the expansion module is not supplied with power/comm. terminal. Order it with the basic module.

### Option module

Type	Analog input/output	Digital input, alarm output	CT input	RS422/RS485 communication output
Model	TMHA-42AE	TMHE-82RE	TMHCT-82NE	TMHC-22SE
Input	Temperature sensor/ Analog input 1 to 4	Digital input 1 to 8	CT input 1 to 8	—
Output	Transmission output (0/4-20mA) 1 to 4	Alarm output 1 to 8	—	COM1, COM2 output


## Comprehensive Device Management Program (DAQMaster)

- DAQMaster is comprehensive device management program. It is available for parameter setting, monitoring.
- Visit our website ([www.autonics.com](http://www.autonics.com)) to download user manual and comprehensive device management program.

< Computer specification for using software >

Item	Minimum requirements
System	IBM PC compatible computer with Intel Pentium III or above
Operating system	Microsoft Windows 98/NT/XP/Vista/7/8/10
Memory	256MB or more
Hard disk	More than 1GB of free hard disk space
VGA	1024×768 or higher resolution display
Others	RS-232 serial port (9-pin), USB port

< DAQMaster screen >

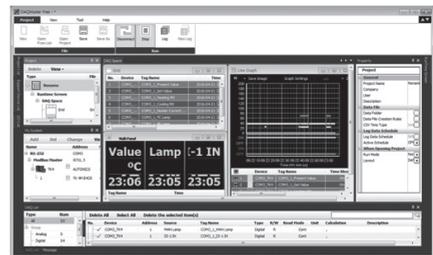


- (A) Photoelectric Sensors
- (B) Fiber Optic Sensors
- (C) Door/Area Sensors
- (D) Proximity Sensors
- (E) Pressure Sensors
- (F) Rotary Encoders
- (G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets
- (H) Temperature Controllers
- (I) SSRs / Power Controllers
- (J) Counters
- (K) Timers
- (L) Panel Meters
- (M) Tacho / Speed / Pulse Meters
- (N) Display Units
- (O) Sensor Controllers
- (P) Switching Mode Power Supplies
- (Q) Stepper Motors & Drivers & Controllers
- (R) Graphic/ Logic Panels
- (S) Field Network Devices
- (T) Software

# TMH Series

## ■ Connection Examples


### ◎ TMH2/4, TMHA, TMHE, TMHCT inter-working configuration example

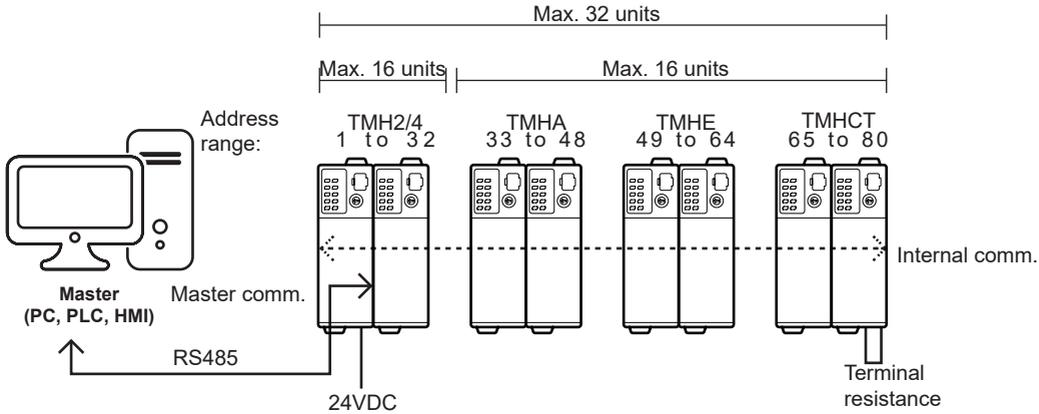

※ Internal communication: Receive/Send data between TMH2/4 and TMHA/E/CT External communication: Communicate with Master for controlling

- Each module is available to monitoring at DAQMaster via PC loader

### ◎ TMHC configuration example

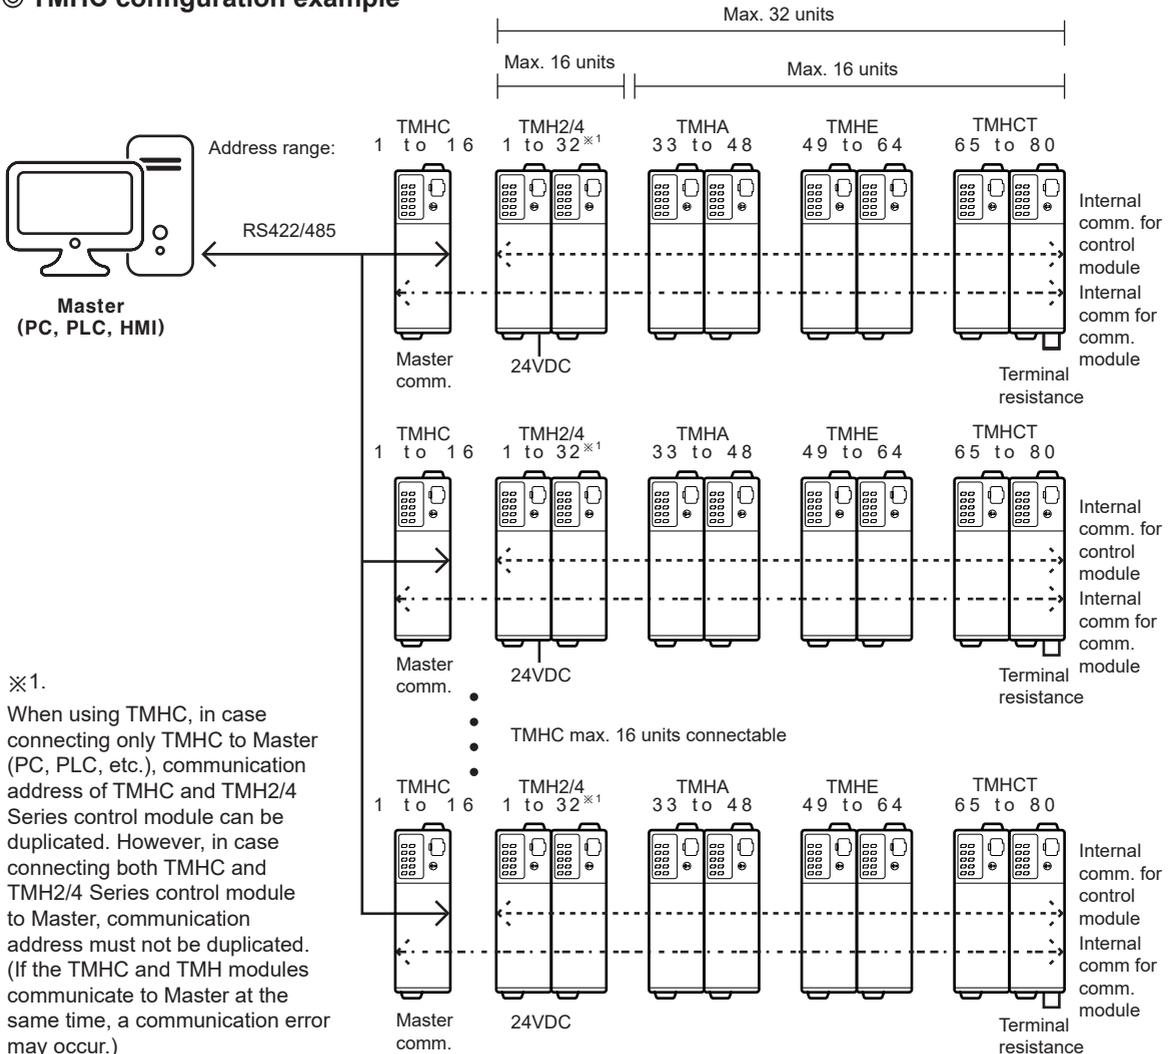

※1.

When using TMHC, in case connecting only TMHC to Master (PC, PLC, etc.), communication address of TMHC and TMH2/4 Series control module can be duplicated. However, in case connecting both TMHC and TMH2/4 Series control module to Master, communication address must not be duplicated. (If the TMHC and TMH modules communicate to Master at the same time, a communication error may occur.)

# Multi-Channel Modular Type High Performance

## ■ Specifications

### ◎ Control module

Series		TMH2	TMH4
No. of channels		2 channels	4 channels
Power supply		24VDC $\overline{=}$	
Permissible voltage range		90 to 110% of rated voltage	
Power consumption		Max. 5W (for max. load)	
Display method		None- parameter setting and monitoring is available at external devices (PC, PLC, etc.)	
Input type	Thermocouple	K(CA), J(IC), E(CR), T(CC), B(PR), R(PR), S(PR), N(NN), C(TT), G(TT), L(IC), U(CC), Platinel II	
	RTD	DPt100 $\Omega$ , JPt100 $\Omega$ , DPt50 $\Omega$ , Cu100 $\Omega$ , Cu50 $\Omega$ , Nickel 120 $\Omega$ 3-wire type (permissible line resistance max. 5 $\Omega$ )	
	Analog	<ul style="list-style-type: none"> <li>• Voltage: 0-100mVDC<math>\overline{=}</math>, 0-5VDC<math>\overline{=}</math>, 1-5VDC<math>\overline{=}</math>, 0-10VDC<math>\overline{=}</math></li> <li>• Current: 0-20mA, 4-20mA</li> </ul>	
Sampling cycle		50ms (2CH or 4CH synchronous sampling)	
Measured accuracy	Thermocouple $\times 1$	<ul style="list-style-type: none"> <li>• At room temperature (23°C<math>\pm</math>5°C): (PV <math>\pm</math>0.3% or <math>\pm</math>1°C, higher one) <math>\pm</math>1-digit<math>\times 2</math></li> <li>• Out of room temperature range: (PV <math>\pm</math>0.5% or <math>\pm</math>2°C, higher one) <math>\pm</math>1-digit</li> </ul>	
	RTD	<ul style="list-style-type: none"> <li>• At room temperature (23°C<math>\pm</math>5°C): <math>\pm</math>0.3% F.S. <math>\pm</math>1-digit</li> <li>• Out of room temperature range: <math>\pm</math>0.5% F.S. <math>\pm</math>1-digit</li> </ul>	
	Analog	<ul style="list-style-type: none"> <li>• At room temperature (23°C<math>\pm</math>5°C): <math>\pm</math>0.3% F.S. <math>\pm</math>1-digit</li> <li>• Out of room temperature range: <math>\pm</math>0.5% F.S. <math>\pm</math>1-digit</li> </ul>	
Option input	CT input	0.0-50.0A (primary current measurement range) $\times$ CT ratio=1/1000 Measured accuracy: $\pm$ 5% F.S. $\pm$ 1-digit	
	Digital input	<ul style="list-style-type: none"> <li>• Connect input: ON - max. 1k<math>\Omega</math>, OFF - min. 100k<math>\Omega</math></li> <li>• Solid-state input: ON - max. residual voltage 0.9V, OFF - max. leakage current 0.5mA</li> <li>• Outflow current : approx. 0.3mA per input</li> </ul>	—
Control method	Heating, Cooling	ON/OFF control, P, PI, PD, PID control	
	Heating&Cooling		
Control output	Relay	250VAC $\sim$ 3A 1a	
	SSR	Max. 12VDC $\overline{=}$ $\pm$ 3V 20mA	
	Current	Selectable DC 4-20mA or DC 0-20mA (load resistance max. 500 $\Omega$ )	
Option output	Alarm	250VAC $\sim$ 3A 1a	—
	Communication	Master	RS485 communication output (Modbus RTU)
	PC loader	Serial (TTL Level), half duplex	
Hysteresis		RTD/Thermocouples: 1 to 100°C/°F (0.1 to 100.0°C/°F), analog: 1 to 100 digit	
Proportional band (P)		RTD/Thermocouples: 1 to 999°C/°F (0.1 to 999.9°C/°F), analog: 0.1 to 999.9 digit	
Integral time (I)		0 to 9999 sec	
Derivative time (D)		0 to 9999 sec	
Control period (T)		Relay output: 0.1 to 120.0 sec, SSR output: 1.0 to 120.0 sec	
Manual reset		0 to 100% (0.0 to 100.0%)	
Relay life cycle	Mechanical	Min. 10,000,000 operations	
	Electrical	Min. 100,000 operations (250VAC 3A resistance load)	
Memory retention		Approx. 10 years (non-volatile semiconductor memory type)	
Insulation resistance		100M $\Omega$ (at 500VDC megger)	
Insulation type		Double insulation or reinforced insulation (mark: $\square$ , dielectric strength between the measuring input part and the power part: 1kV)	
Dielectric strength		1,000VAC 50/60Hz for 1 min (between input terminals and power terminals)	
Vibration		0.75mm amplitude at frequency of 5 to 55Hz (for 1 min) in each X, Y, Z direction for 2 hours	
Noise immunity		$\pm$ 0.5kV the square wave noise (pulse width: 1 $\mu$ s) by the noise simulator	
Environment	Ambient temp.	-10 to 50°C, storage: -20 to 60°C	
	Ambient humi.	35 to 85%RH, storage: 35 to 85%RH	
Protection structure		IP20 (IEC standard)	
Accessories		Expansion connector: 1, module lock connector: 2	
Approval		CE,  , 	
Weight $\times 3$	Basic module	Approx. 250.8g (approx. 177.7g)	Approx. 250.4g (approx. 177.3g)
	Expansion module	Approx. 245.7g (approx. 172.6g)	Approx. 245.1g (approx. 172.2g)

$\times 1$ : Connecting 1 or more expansion module can vary measurement accuracy about  $\pm$ 1°C, regardless of the number of connected expansion module.

$\times 2$ : ◎At room temperature (23°C $\pm$ 5°C)

- Thermocouple K, J, N, E below -100°C, L, U, PLII and RTD Cu50 $\Omega$ , DPt50 $\Omega$ : (PV  $\pm$ 0.3% or  $\pm$ 2°C, higher one)  $\pm$ 1-digit
- Thermocouple C, G and R, S below 200°C: (PV  $\pm$ 0.3% or  $\pm$ 3°C, higher one)  $\pm$ 1-digit
- Thermocouple B below 400°C: there is no accuracy standards.

◎Out of room temperature range

- RTD Cu50 $\Omega$ , DPt50 $\Omega$ : (PV  $\pm$ 0.5% or  $\pm$ 3°C, higher one)  $\pm$ 1-digit
- Thermocouple R, S, B, C, G: (PV  $\pm$ 0.5% or  $\pm$ 5°C, higher one)  $\pm$ 1-digit
- Others blow -100°C: within  $\pm$ 5°C

$\times 3$ : The weight includes packaging. The weight in parenthesis is for unit only.  $\times$ Environment resistance is rated at no freezing or condensation.

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers

(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software

# TMH Series

## ■ Specifications

### ◎ Option module

Model	TMHA-42AE		TMHE-82RE	TMHCT-82NE	TMHC-22SE
No. of channels	4 channels		8 points	8 points	COM1, COM2
Power supply <sup>※1</sup>	24VDC=				
Permissible voltage range	90 to 110% of rated voltage				
Power consumption	Max. 5W (for max. load)				
Display method	None- parameter setting and monitoring is available at external devices (PC, PLC, etc.)				
Input type	Thermocouple	RTD	Analog	Digital	CT
	K(CA), J(IC), E(CR), T(CC), B(PR), R(PR), S(PR), N(NN), C(TT), G(TT), L(IC), U(CC), Platinel II	DPT100Ω, JPT100Ω, DPT50Ω, Cu100Ω, Cu50Ω, Nikel 120Ω 3-wire type (permissible line resistance max. 5Ω per line)	<ul style="list-style-type: none"> <li>Voltage: 0-100mVDC=, 0-5VDC=, 1-5VDC=, 0-10VDC=</li> <li>Current: 0-20mA, 4-20mA</li> </ul>	<ul style="list-style-type: none"> <li>Connect input: ON - max. 1kΩ, OFF - min. 100kΩ</li> <li>Solid-state input: ON - max. residual voltage 0.9V, OFF - max. leakage current 0.5mA</li> <li>Outflow current : approx. 0.3mA per input</li> </ul>	0.0-50.0A (primary current measurement range) ※CT ratio=1/1000
Sampling cycle	50ms (4CH synchronous sampling)				
Measured accuracy <sup>※2</sup>	<ul style="list-style-type: none"> <li>At room temperature (23°C±5°C): (PV ±0.3% or ±1°C, higher one) ±1-digit<sup>※3</sup></li> <li>Out of room temperature range: (PV ±0.5% or ±2°C, higher one) ±1-digit</li> </ul>		<ul style="list-style-type: none"> <li>At room temperature (23°C±5°C): ±0.3% F.S. ±1-digit</li> <li>Out of room temperature range: ±0.5% F.S. ±1-digit</li> </ul>		±5% F.S. ±1-digit
	Alarm	—		250VAC~ 3A 1a	
Output	Transmission	DC 4-20mA or DC 0-20mA (load resistance max. 500Ω)			
Comm.	Master	RS485 communication output (Modbus RTU)			RS485/RS422 (Modbus RTU)
	PC loader	Serial (TTL Level), half duplex			
Relay life cycle	Mechanical	—		Min. 10,000,000 operations	
	Electrical	—		Min. 100,000 operations (250VAC 3A resistance load)	
Memory retention	Approx. 10 years (non-volatile semiconductor memory type)				
Insulation resistance	Over 100MΩ (500VDC megger)				
Insulation type	Double insulation or reinforced insulation (mark: □, dielectric strength between the measuring input part and the power part : 1kV)				
Dielectric strength	1,000VAC 50/60Hz for 1 min (between power source terminal and input terminal)				
Vibration	0.75mm amplitude at frequency of 5 to 55Hz (for 1 min) in each X, Y, Z direction for 2 hours				
Noise immunity	Square shaped noise by noise simulator (pulse width 1μs) ±0.5kV R-phase, S-phase				
Environ-ment	Ambient temp.	-10 to 50°C, storage: -20 to 60°C			
	Ambient humi.	35 to 85%RH, storage: 35 to 85%RH			
Protection structure	IP20 (IEC standard)				
Accessories	Expansion connector: 1, module lock connector: 2				
Approval	CE  				
Weight <sup>※4</sup>	Approx. 233.8g (approx. 160.7g)		Approx. 239g (approx. 165.9g)	Approx. 220.6g (approx. 147.5g)	Approx. 222.1g (approx. 149.0g)

※1: Voltage of power supply/communication terminal placed in the backside of TMH2/4 Series (basic control module)

※2: In case of TMHA, connecting 1 or more expansion module can vary measurement accuracy about ±1°C, regardless of the number of connected expansion module.

※3: **At room temperature (23°C±5°C)**

- Thermocouple K, J, N, E below -100°C, L, U, PLII and RTD Cu50Ω, DPT50Ω: (PV ±0.3% or ±2°C, higher one) ±1-digit
- Thermocouple C, G and S below 200°C: (PV ±0.3% or ±3°C, higher one) ±1-digit
- Thermocouple B below 400°C: there is no accuracy standards.

**Out of room temperature range**

- RTD Cu50Ω, DPT50Ω: (PV ±0.5% or ±3°C, higher one) ±1-digit
- Thermocouple R, S, B, C, G: (PV ±0.5% or ±5°C, higher one) ±1-digit
- Others blow -100°C: within ±5°C

※4: The weight includes packaging. The weight in parenthesis is for unit only.

※Environment resistance is rated at no freezing or condensation.

# Multi-Channel Modular Type High Performance

## ■ Error Display

Indicator \ Status	Input error※ <sup>1</sup>	Remote SV error※ <sup>2</sup>
PRW	ON (red)	ON (green)
CH※ <sup>3</sup>	Flash (red)	Flash (red)

※1: Input error: input value is below the input range (LLLL) / input value exceeds input range (HHHH) / input sensor wire is down or input sensor is disconnected (OPEN).

※2: Remote SV error: communication error of Remote SV master and internal communication / input of master channel is LLLL/HHHH/OPEN when the channel is subjected to display PV.


※3: An indicator of relative channel flashes.

After main cause of the error is solved, error status is cleared and the device is returned to the normal operation automatically.



## ■ Dimensions

(unit: mm)

●Rail Lock position:  
mounting with bolts

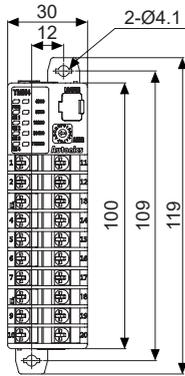


●Rail Lock position:  
mounting on DIN Rail

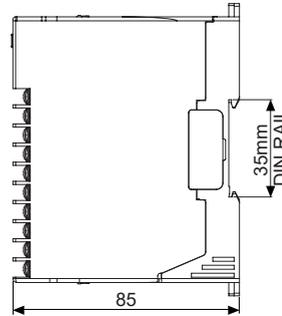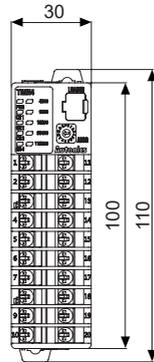

## ■ Unit Description

### ◎ Control module

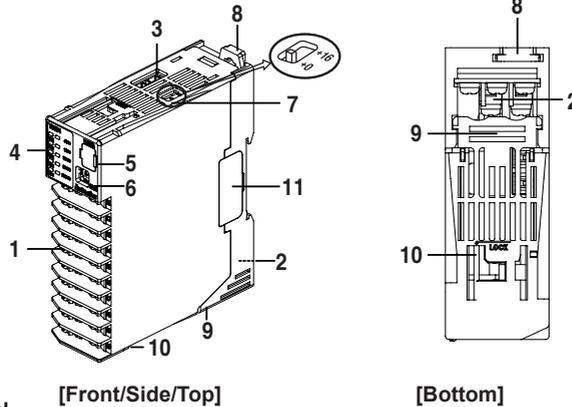

[Front/Side/Top]

[Bottom]

#### 1. Input/Output terminal

For specific information about terminal formation, please refer to 'Connections and Isolated Block Diagram'.

#### 2. Power/Comm. terminal [basic module only]


Supplies power to both basic control/expansion module and communicates with one or more module.

#### 3. CT input terminal

When using the CT input terminal, remove the rubber cap and connect CT in the same direction with right image.

Connect CT with CICT4-□(CT connector cable, sold separately).

※When connecting CT connector and CT input terminal, align the concave part (凹) and the convex part (凸).



(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers


(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software

# TMH Series

## © Control module

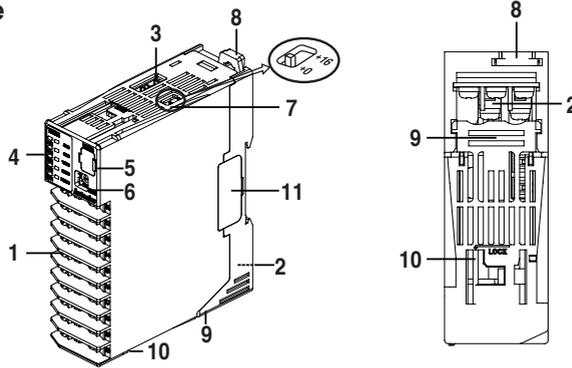

### 4. Indicator

[Front/Side/Top]

[Bottom]

#### •TMH2 Series

Indicator	Status	Initial power ON <sup>※1</sup>	Control output	Auto tuning <sup>※2</sup>	Alarm output			
					N.O. (Normally Open)		N.C. (Normally Closed)	
					OFF (OPEN)	ON (CLOSE)	OFF (CLOSE)	ON (OPEN)
LED 1 LED 2 PWR CH 1 AL 1 CH 2 AL 2 AL 3 AL 4	LED 1	PWR (green) <sup>※3</sup>	—	ON	ON	—		
		CH1 (red)	—	ON	Flash	—		
		CH2 (red)	—	ON	Flash	—		
		(red)	—	ON	OFF	—		
		(red)	—	ON <sup>※4</sup>	OFF	—		
LED 2	(yellow)	Flash (4,800bps)	—	—	Module comm. status <sup>※6</sup>			
	AL1 (yellow)	Flash (9,600bps)	—	—	OFF	ON	OFF	ON
	AL2 (yellow)	Flash (19,200bps)	—	—	OFF	ON	OFF	ON
	AL3 (yellow)	Flash (38,400bps)	—	—	OFF	ON	OFF	ON
	AL4 (yellow)	Flash (115,200bps)	—	—	OFF	ON	OFF	ON

#### •TMH4 Series

Indicator	Status	Initial power ON <sup>※1</sup>	Control output	Auto tuning <sup>※2</sup>	
LED 1 LED 2 PWR CH 1 CH 2 CH 3 CH 4	LED 1	PWR (green) <sup>※3</sup>	—	ON	ON
		CH1 (red)	—	ON	Flash
		CH2 (red)	—	ON	Flash
		CH3 (red)	—	ON	Flash
		CH4 (red)	—	ON	Flash
LED 2	(yellow)	Flash (4,800bps)	—	—	Module comm. status <sup>※6</sup>
	(yellow)	Flash (9,600bps)	—	—	
	(yellow)	Flash (19,200bps)	—	—	
	(yellow)	Flash (38,400bps)	—	—	
	(yellow)	Flash (115,200bps)	—	—	

※1: At the moment when power is on, the indicator of set communication speed flashes for 5 sec.

※2: Indicator of the channel, which is in the process of auto-tuning, flashes at 1 sec interval.

※3: When communicating with external device, PWR indicator flashes.

※4: Turns on, when CH1 outputs cooling control in the heating&cooling control method.

※5: Turns on, when CH2 outputs cooling control in the heating&cooling control method.

※6: Displays communication status in control output, auto-tuning or operating RUN mode.

ON: normal / flash: abnormal / OFF: not communicating

**5. PC loader port:** PC loader port supports serial communication between single module and PC.

It needs EXT-US (converter cable)+SCM-US (USB/Serial converter, sold separately) for communicating.

**6. Communication address setting switch (SW1):** Set the communication address.

If changing the communication address by setting switch, use the flat head driver which is 2mm size or plastic driver. If not, it may cause product damage.

**7. Communication address group switch (SW2):** When setting the communication address over 16, select +16.

**8. Rail lock:** Rail lock helps installing the device to DIN rail or with bolts.


**9. Lock lever:** Lock lever holds module body and base tightly.

**10. Module lock connector hole:** When connect modules, insert module lock connector in the hole in order to enhance coherence between modules.

**11. END cover:** When connect modules, remove END cover in order to connect expansion connector.

# Multi-Channel Modular Type High Performance

## ◎ Option module

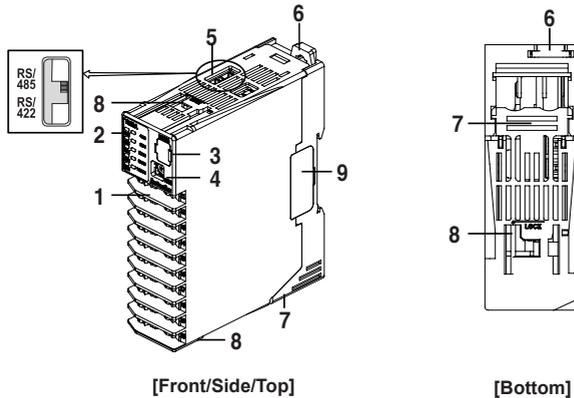

### 1. Input/Output terminal

For specific information about terminal formation, please refer to 'Connections and Isolated Block Diagram'.

### 2. Indicator

#### ●TMHA [analog input/output module]

Indicator		Status	Initial power ON <sup>*1</sup>	Internal comm.	Transmission output
LED 1 LED 2 PWR CH 1 CH 2 CH 3 CH 4	LED 1	PWR (green) <sup>*2</sup>	—	ON	ON
		CH1 (red)		—	ON
		CH2 (red)		—	ON
		CH3 (red)		—	ON
		CH4 (red)		—	ON
	LED 2	(yellow)	Flash (4,800bps)	Module comm. status <sup>*3</sup>	—
		(yellow)	Flash (9,600bps)	ON (CH1)	—
		(yellow)	Flash (19,200bps)	ON (CH2)	—
		(yellow)	Flash (38,400bps)	ON (CH3)	—
		(yellow)	Flash (115,200bps)	ON (CH4)	—

#### ●TMHE [digital input, alarm output module]

Indicator		Status	Initial power ON <sup>*1</sup>	Internal comm.	Alarm output				
					N.O. (Normally Open)		N.C. (Normally Closed)		
					OFF (OPEN)	ON (CLOSE)	OFF (CLOSE)	ON (OPEN)	
LED 1 LED 2 PWR AL 1 AL 5 AL 2 AL 6 AL 3 AL 7 AL 4 AL 8	LED 1	PWR (green) <sup>*2</sup>	—	ON	ON	OFF	ON	OFF	ON
		CH1 (red)		—	OFF	ON	OFF	ON	
		CH2 (red)		—	OFF	ON	OFF	ON	
		CH3 (red)		—	OFF	ON	OFF	ON	
		CH4 (red)		—	OFF	ON	OFF	ON	
	LED 2	(yellow)	Flash (4,800bps)	Module comm. status <sup>*3</sup>	Module comm. status <sup>*3</sup>	OFF	ON	OFF	ON
		AL5 (yellow)	Flash (9,600bps)	—	OFF	ON	OFF	ON	
		AL6 (yellow)	Flash (19,200bps)	—	OFF	ON	OFF	ON	
		AL7 (yellow)	Flash (38,400bps)	—	OFF	ON	OFF	ON	
		AL8 (yellow)	Flash (115,200bps)	—	OFF	ON	OFF	ON	

#### ●TMHCT [CT input module]

Indicator		Status	Initial power ON <sup>*1</sup>	CT input <sup>*4</sup>	Internal comm.
LED 1 LED 2 PWR AL 1 AL 5 AL 2 AL 6 AL 3 AL 7 AL 4 AL 8	LED 1	PWR (green) <sup>*2</sup>	—	ON	ON
		(red)		ON (40.1 to 50.0A)	—
		(red)		ON (30.1 to 40.0A)	—
		(red)		ON (20.1 to 30.0A)	—
		(red)		ON (10.1 to 20.0A)	—
	LED 2	(yellow)	Flash (4,800bps)	Module comm. status <sup>*3</sup>	Module comm. status <sup>*3</sup>
		(yellow)	Flash (9,600bps)	ON (40.1 to 50.0A)	—
		(yellow)	Flash (19,200bps)	ON (30.1 to 40.0A)	—
		(yellow)	Flash (38,400bps)	ON (20.1 to 30.0A)	—
		(yellow)	Flash (115,200bps)	ON (10.1 to 20.0A)	—

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers


(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software

# TMH Series

## ◎ Option module

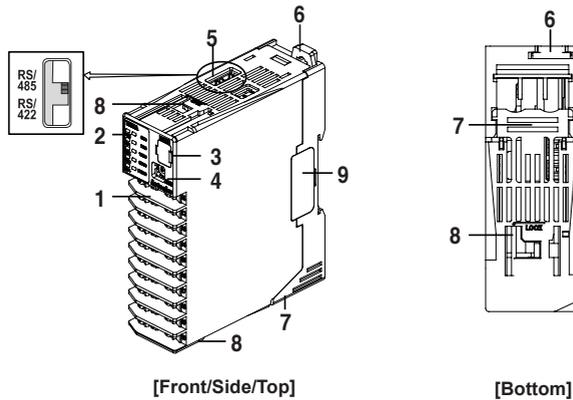

## 2. Indicator

### ●TMHC [RS422/RS485 communication output module]

Indicator		Status	Initial power ON <sup>※5</sup>	Internal comm.	Connection
LED 1 LED 2 PWR □ □	LED 1	PWR (green) <sup>※2</sup>	Flash (4,800bps)	—	—
		(red)	Flash (9,600bps)	Flash (TMH2/4)	—
		(red)	Flash (19,200bps)	Flash (TMHA)	—
		(red)	Flash (38,400bps)	Flash (TMHE)	—
		(red)	Flash (115,200bps)	Flash (TMHCT)	—
□ □ □ □ □ □	LED 2	(yellow)	Flash (4,800bps)	—	Module comm. status <sup>※3</sup>
		(yellow)	Flash (9,600bps)	—	ON (TMH2/4)
		(yellow)	Flash (19,200bps)	—	ON (TMHA)
		(yellow)	Flash (38,400bps)	—	ON (TMHE)
		(yellow)	Flash (115,200bps)	—	ON (TMHCT)

※1: At the moment when power is on, the indicator of set communication speed flashes for 5 sec.

※2: When communicating with external device, PWR indicator flashes.

※3: Displays internal communication status between modules.

ON: normal / flash: abnormal / OFF: not communicating

※4: The indicator corresponding to the certain setting value of CT input flashes according to the parameter [CT Input Value Indication Lamp □].

LED 1: CT Input Value Indication Lamp1 / LED 2: CT Input Value Indication Lamp2

※5: At the moment when power is on, the indicator corresponding to host communication speed flashes for 5 sec.

LED 1: host 1 / LED 2: host 2

**3. PC loader port:** PC loader port supports serial communication between single module and PC. It needs EXT-US (converter cable)+SCM-US (USB/Serial converter, sold separately) for communicating.

**4. Communication address setting switch (SW1):** Set the communication address.

If changing the communication address by setting switch, use the flat head driver which is 2mm size or plastic driver. If not, it may cause product damage.

**5. Communication mode switch (SW2):** Select communication mode between RS485 and RS422. (TMHC only)

**6. Rail lock:** Rail lock helps installing the device to DIN rail or with bolts.

**7. Lock lever:** Lock lever holds module body and base tightly.

**8. Module lock connector hole:** When connect modules, insert module lock connector in the hole in order to enhance coherence between modules.

**9. END cover:** When connect modules, remove END cover in order to connect expansion connector.

# Multi-Channel Modular Type High Performance


## ■ Connections and Isolated Block Diagram

※Use terminals of size specified below.

		
	<Round>	<Forked>
a	Min. 3.0mm	Min. 3.0mm
b	Max. 5.8mm	Max. 5.8mm


## ◎ Control module

### ●CT input terminal on the top

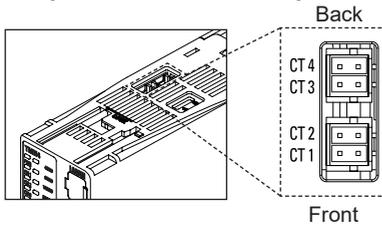


- ※When use the CT input terminals, remove the robber cap.
- ※Connect CT with CICT4-□(CT connector cable, sold separately).


### ●Power/Comm. terminal on the back [basic module only]

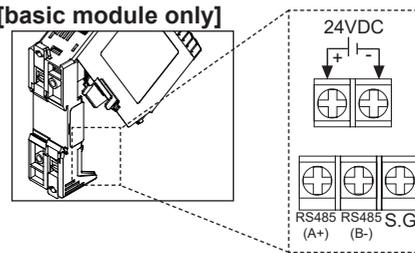

### ●TMH2 Series

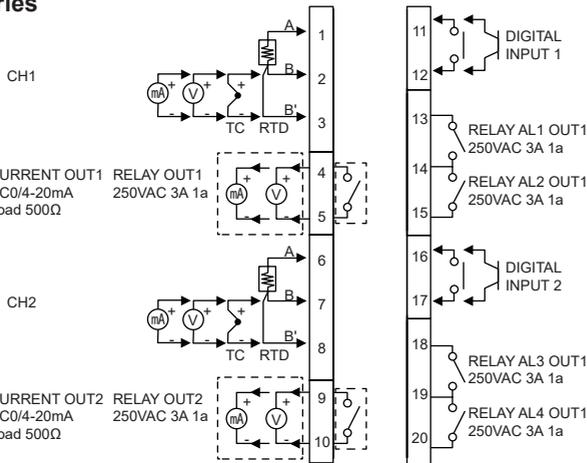

### ●TMH4 Series

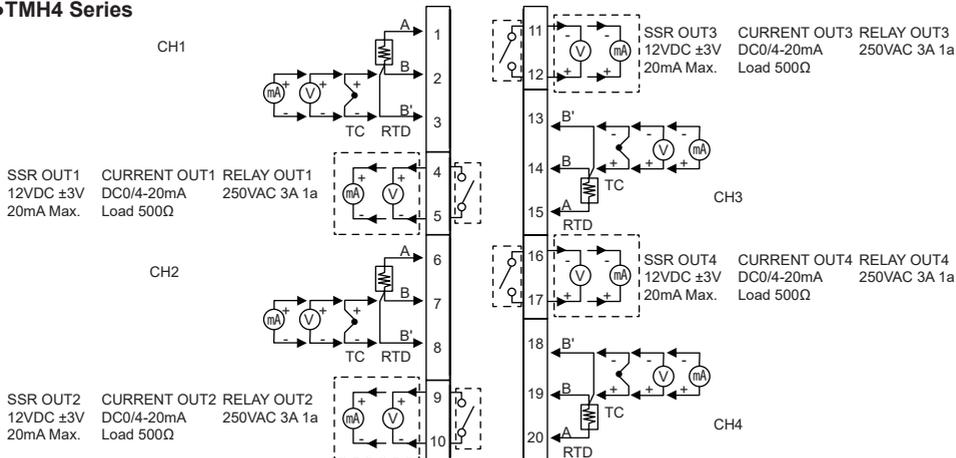

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers

(R) Graphic/ Logic Panels


(S) Field Network Devices

(T) Software


# TMH Series

## ◎ Option module


### ●TMHA [analog input/output module]

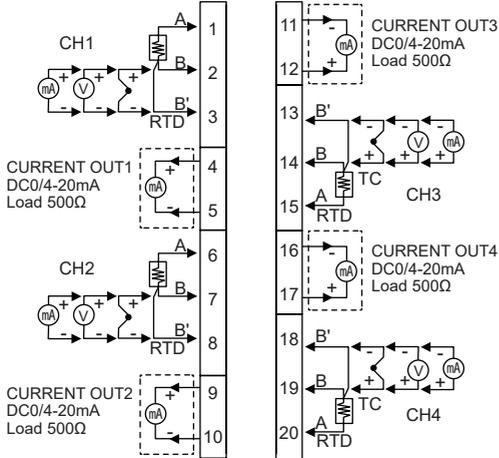


### ●TMHE [digital input, alarm output module]

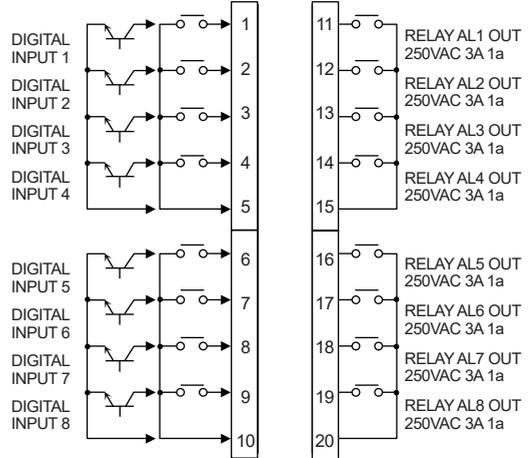

### ●TMHCT [CT input module]

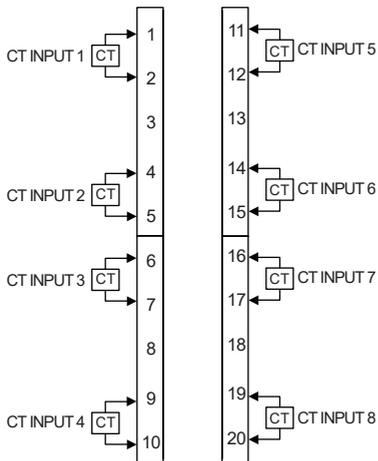

### ●TMHC [RS422/RS485 communication output module]

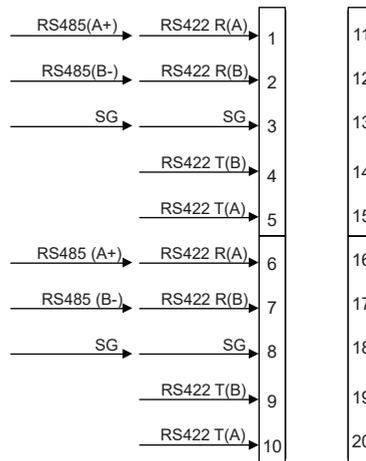

## ■ Sold Separately

### ◎ Communication converter

#### ● SCM-WF48

(Wi-Fi to RS485-USB wireless communication converter)  
CE



#### ● SCM-US481

(USB to RS485 converter)  
CE



#### ● SCM-381

(RS232C to RS485 converter)  
CE



#### ● SCM-US

(USB to Serial converter)  
CE



#### ● EXT-US

(converter cable)





# Multi-Channel Modular Type High Performance

## ■ Sold Separately



### ◎ Current transformer (CT)

#### ● CSTC-E80LN

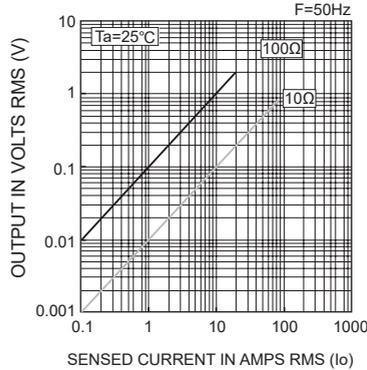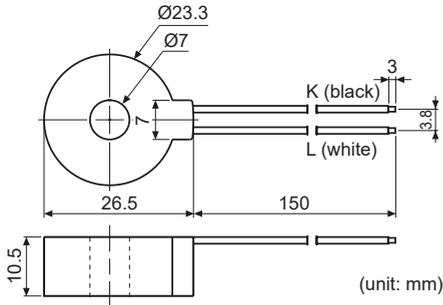



- Max. load current: 80A (50/60Hz)  
※Max. load current for TMH Series is 50A.
- Current ratio: 1/1000
- Wire wound resistance:  $31\Omega \pm 10\%$

#### ● CSTC-E200LN

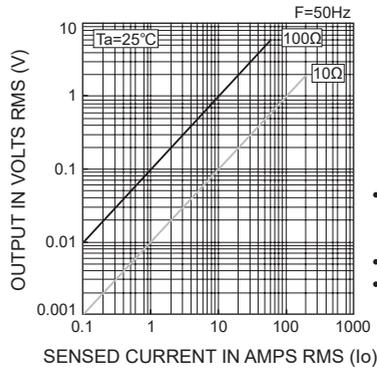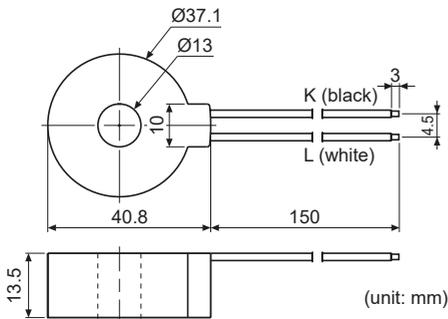

- Max. load current: 200A (50/60Hz)  
※Max. load current for TMH Series is 50A.
- Current ratio: 1/1000
- Wire wound resistance:  $20\Omega \pm 10\%$

#### ● CSTS-E80PP

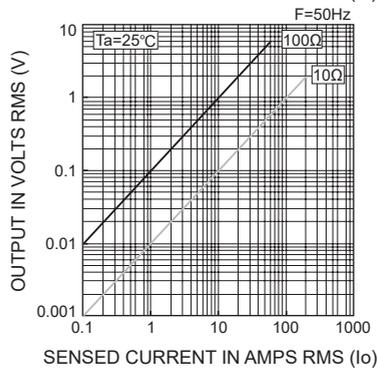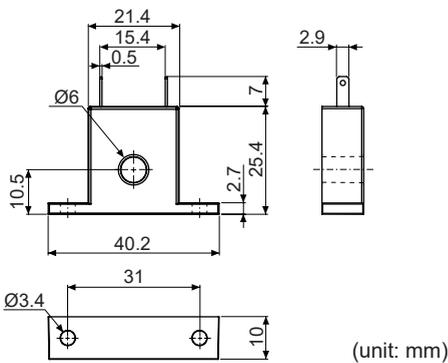


- Max. load current: 80A (50/60Hz)  
※Max. load current for TMH Series is 50A.
- Current ratio: 1/1000
- Wire wound resistance:  $31\Omega \pm 10\%$

※Do not supply primary current in case that CT output is open. High voltage will be generated in CT output.  
 ※The current for above CTs is 50A same but inner hole sizes are different. Please use this for your environment.

### ◎ CT connector cable

- CICT4-1 (cable length: 1m)
- CICT4-3 (cable length: 3m)

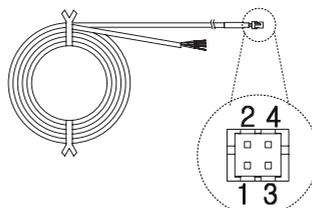

※When connecting CT connector and CT input terminal, align the concave part (凹) and the convex part (凸).

(A)	Photoelectric Sensors
(B)	Fiber Optic Sensors
(C)	Door/Area Sensors
(D)	Proximity Sensors
(E)	Pressure Sensors
(F)	Rotary Encoders
(G)	Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets
(H)	Temperature Controllers
(I)	SSRs / Power Controllers
(J)	Counters
(K)	Timers
(L)	Panel Meters
(M)	Tacho / Speed / Pulse Meters
(N)	Display Units
(O)	Sensor Controllers
(P)	Switching Mode Power Supplies
(Q)	Stepper Motors & Drivers & Controllers
(R)	Graphic/ Logic Panels
(S)	Field Network Devices
(T)	Software

# TMH Series

## ◎ Display units (DS/DA-T Series)

- DS/DA-T Series CE  
(RS485 communication input type display unit)



DS16-T



DS22/DA22-T



DS40/DA40-T




DS60/DA60-T

※Connect RS485 communication input type display unit (DS/DA-T Series) and RS485 communication of TMH Series, the display unit displays present value of the device without PC/PLC.

## ■ Installation

### 1. Separating base terminal block

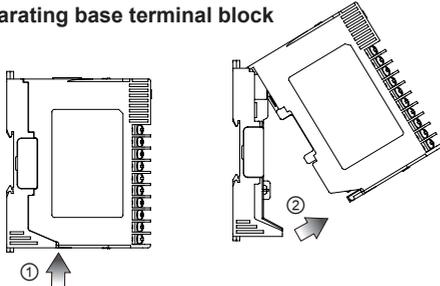


- ① Push the lock lever at the bottom of the module.
- ② Pull the body of the module and open up.

※When connecting base terminal block, align the upper concave part (凹) of the body and the upper convex part (凸) of the base. If the upper parts are not align correctly, it may damage to the inner connector.

### 2. Connection between modules


TMH□-□2□B (basic module)    TMH□-□2□E (expansion module)    TMH□-□2□E (expansion module)

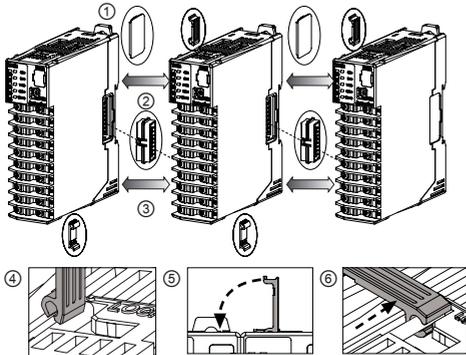

- ① Remove END cover of each module (except END cover of the first and last module).
  - ② Insert expansion connector.
  - ③ Put all together tightly (max. 31 units).
  - ④ Insert module lock connector.
  - ⑤ Push module lock connector and insert in lock connector hole of another module on the side.
  - ⑥ Push module lock connector to the lock direction.
- ※Supply adequate power for power input specifications and overall capacity.  
(Max. power when connecting 32 modules:  $32 \times 5W = 160W$ )




### 3. Mounting with bolts

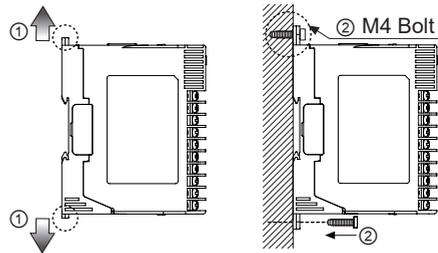

- ① Pull the rail lock at the top and bottom of the module.
- ② Insert bolts and fix it on rail lock. (fixing torque is 0.5 to 0.9N·m.)


### 4. Mounting on DIN rail

#### 4.4.1 Installing




- ① Hang the top rail lock to DIN rail.
- ② Push and press the module to down direction.

#### 4.2 Removing




- ① Press the module down.
- ② Pull the module body forward.

※Use end plates (sold separately, not available from Autonics) to fix firmly.



※Install the module vertically.



# Multi-Channel Modular Type High Performance

## Input Type and Range

Input type		Decimal point	Display	Temperature range(°C)	Temperature range(°F)	
Thermo-couple	K(CA)	1	K(CA).H	-200 to 1350	-328 to 2463	
		0.1	K(CA).L	-200.0 to 1350.0	-328.0 to 2463.0	
	J(IC)	1	J(IC).H	-200 to 800	-328 to 1472	
		0.1	J(IC).L	-200.0 to 800.0	-328.0 to 1472.0	
	E(CR)	1	E(CR).H	-200 to 800	-328 to 1472	
		0.1	E(CR).L	-200.0 to 800.0	-328.0 to 1472.0	
	T(CC)	1	T(CC).H	-200 to 400	-328 to 752	
		0.1	T(CC).L	-200.0 to 400.0	-328.0 to 752.0	
	B(PR)	1	B(PR)	0 to 1800	32 to 3272	
	R(PR)	1	R(PR)	0 to 1750	32 to 3182	
	S(PR)	1	S(PR)	0 to 1750	32 to 3182	
	N(NN)	1	N(NN)	-200 to 1300	-328 to 2372	
	C(TT)	1	C(TT)	0 to 2300	32 to 4172	
	G(TT)	1	G(TT)	0 to 2300	32 to 4172	
	L(IC)	1	L(IC).H	-200 to 900	-328 to 1652	
0.1		L(IC).L	-200.0 to 900.0	-328.0 to 1652.0		
U(CC)	1	U(CC).H	-200 to 400	-328 to 752		
	0.1	U(CC).L	-200.0 to 400.0	-328.0 to 752.0		
Platinel II	1	PLII	0 to 1390	32 to 2534		
RTD	Cu 50Ω		0.1	CU 50	-200.0 to 200.0	-200.0 to 392.0
	Cu 100Ω		0.1	CU 100	-200.0 to 200.0	-200.0 to 392.0
	JIS standard	JPt 100Ω	1	JPt100.H	-200 to 650	-328 to 1202
		JPt 100Ω	0.1	JPt100.L	-200.0 to 650.0	-328.0 to 1202.0
	DIN standard	DPt 50Ω	0.1	DPt50.L	-200.0 to 600.0	-328.0 to 1202.0
		DPt 100Ω	1	DPt100.H	-200 to 650	-328 to 1202
		DPt 100Ω	0.1	DPt100.L	-200.0 to 650.0	-328.0 to 1202.0
Nickel 120Ω		1	NI12	-80 to 200	-112 to 392	
Analog	Voltage	0 to 10V	—	AV1	0 to 1000	
		0 to 5V	—	AV2	0 to 5000	
		1 to 5V	—	AV3	1000 to 5000	
		0 to 100mV	—	AMV1	0 to 1000	
	Current	0 to 20mA	—	AMA1	0 to 2000	
		4 to 20mA	—	AMA2	400 to 2000	

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors &amp; Drivers &amp; Controllers

(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software

# TMH Series

## ■ Functions

### 1. Analog input special function TMH2/4 TMHA

In case of analog input, it displays the applied measured value of the set special function.

#### 1) Linear

It applies low-limit scale and high-limit scale to low-limit input value and high-limit input value and displays this values.

E.g.) In case of input type: 0-10V, low-limit input value: 0V, high-limit input value: 10V, low-limit scale: 0, high-limit scale: 1000, present input value is 2V and the display value is 200.

#### 2) Root

In case of voltage, current (shunt) input, this mode is used when input value is calculated by  $\text{Root}(\sqrt{\quad})$  for the desired display value. Differential pressure signal of differential pressure flow meter is calculated  $\text{Root}(\sqrt{\quad})$  for the to-be measured flux. This function is used to measure flux by input value.

E.g.) In case of input type: 0-10V, low-limit input value: 0V, high-limit input value: 10V, low-limit scale: 0, high-limit scale: 1000, present input value is 2V and the display value is 447.

#### 3) Square


In case of voltage, current (shunt) input, this mode is used when input value is calculated by square for the desired display value.

E.g.) In case of input type: 0-10V, low-limit input value: 0V, high-limit input value: 10V, low-limit scale: 0, high-limit scale: 1000, present input value is 2V and the display value is 40.


### 2. Remote SV TMH2/4

SV setting is available to set using PV or SV of the other module/channel not the direct setting of the module/channel.

Set the other module's (RSV Master) address, channel, and the target value (PV or SV).

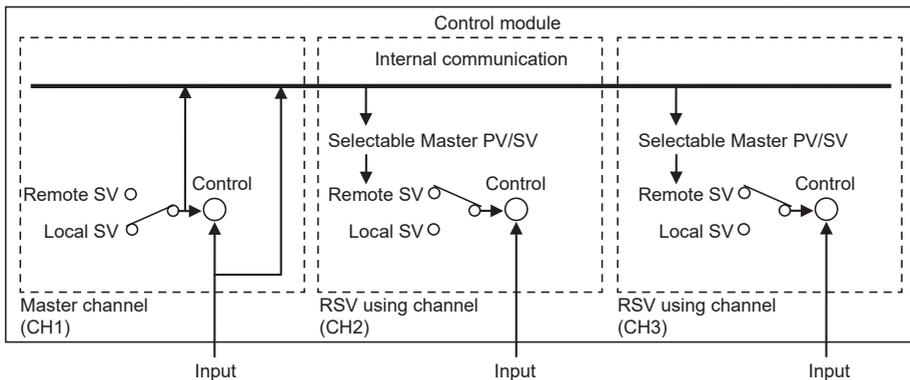

E.g.) RSV function is available when PV of TMHA (address 33, channel 1) is used for SV of TMH2 (address 1, channel 3). Set RSV Master setting of TMH2. RSV Master address: 33, RSV Master channel: 1, RSV Master channel target: PV

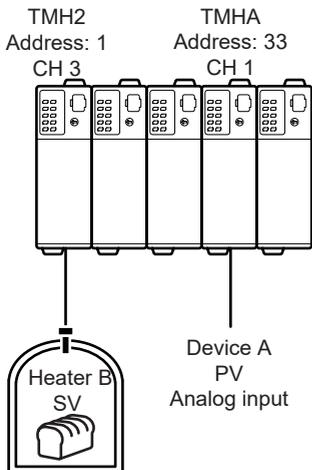

# Multi-Channel Modular Type High Performance

## 3. Alarm TMH2/4 TMHE

Alarm output (Alarm) is output terminal and alarm (Event) is for alarm setting by each channel.

One channel is available to set total 4 alarms (Event 1 to 4).


One alarm consists of alarm mode, option, set value, hysteresis, delay time, output address, and channel settings, etc.

- Using TMHE Option module alarm output

TMH2/4 is connectable to TMHE option module. (according to address setting)

TMH4 does not have built-in alarm and TMHE option module outputs alarm when alarm condition occurs by internal communication.

Several alarm (Event 1 to 4) is selectable as one alarm output and AND/OR operation is selectable at TMHE.

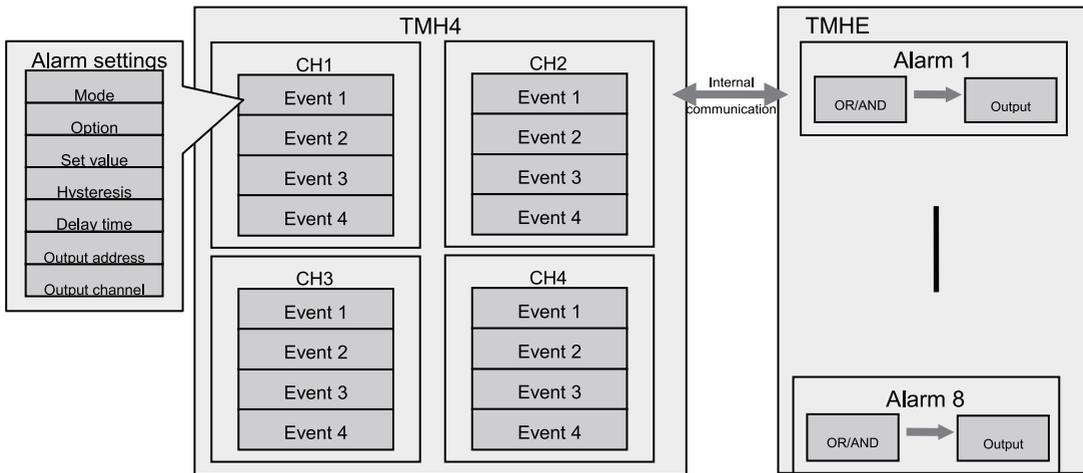

## 4. CT input value indicators channel TMHCT

The indicator of TMHCT turns ON by the input value of CT.

Indicator		Status	CT input
LED 1 LED 2  PWR   	LED 1	PWR (green)	ON
		(red)	ON (40.1 to 50.0A)
		(red)	ON (30.1 to 40.0A)
		(red)	ON (20.1 to 30.0A)
		(red)	ON (10.1 to 20.0A)
	LED 2	(yellow)	—
		(yellow)	ON (40.1 to 50.0A)
		(yellow)	ON (30.1 to 40.0A)
		(yellow)	ON (20.1 to 30.0A)
		(yellow)	ON (10.1 to 20.0A)

Set at LED 1: CT Input Value Indication Lamp1 / LED 2: CT Input Value Indication Lamp2 of TMHC.

## 5. User parameter group TMH2/4 TMHA TMHE TMHCT TMHC

At DAQMaster, user parameter group of each module, TMH2/4/A/E/CT/C, is available to set.

This function is able to set the frequently used parameters to the user parameter group. You can quickly and easily set parameter settings.

For more information, refer to the DAQMaster user manual.

Visit our website ([www.autonics.com](http://www.autonics.com)) to download the DAQMaster program and the user manual.

(A)	Photoelectric Sensors
(B)	Fiber Optic Sensors
(C)	Door/Area Sensors
(D)	Proximity Sensors
(E)	Pressure Sensors
(F)	Rotary Encoders
(G)	Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets
(H)	Temperature Controllers
(I)	SSRs / Power Controllers
(J)	Counters
(K)	Timers
(L)	Panel Meters
(M)	Tacho / Speed / Pulse Meters
(N)	Display Units
(O)	Sensor Controllers
(P)	Switching Mode Power Supplies
(Q)	Stepper Motors & Drivers & Controllers
(R)	Graphic/ Logic Panels
(S)	Field Network Devices
(T)	Software

# TMH Series


## ■ Communication Setting

It is for parameter setting and monitoring via external devices (PC, PLC, etc.).  
In case of TMHC, set COM1/2.

### ◎ Interface

Comm. protocol	Modbus RTU	Comm. speed	4800, 9600 (default), 19200, 38400, 115200 bps
Connection type	RS485, RS422 (RS422, TMHC only)	Response waiting time	5 to 99ms (default: 20ms)
Application standard	EIA RS485 Compliance with	Start bit	1-bit (fixed)
Max. connection	TMH2/4	Data bit	8-bit (fixed)
	TMHA/ TMHE/ TMHCT/ TMHC		
Synchronous method	Asynchronous	Parity bit	None (default), Odd, Even
Comm. method	Two-wire half duplex	Stop bit	1-bit, 2-bit (default)
Comm. effective range	Max. 800m		

### ◎ Application of system organization

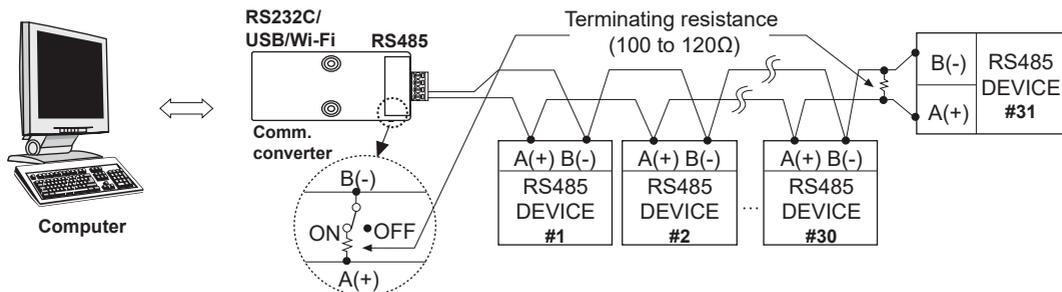

※It is recommended to use Autonics communication converter; SCM-WF48 (Wi-Fi to RS485-USB wireless communication converter, sold separately), SCM-US48I (USB to RS485 converter, sold separately), SCM-38I (RS232C to RS485 converter, sold separately).

Please use twisted pair wire, which is suitable for RS485 communication, for SCM-WF48, SCM-US48I and SCM-38I.

### ◎ Communication address setting

Set the communication address with the communication address setting switch (SW1). (default: [SW1] 1)

Module	SW																
	0	1	2	3	4	5	6	7	8	9	A	B	C	D	E	F	
TMH4/2	+0	16	01	02	03	04	05	06	07	08	09	10	11	12	13	14	15
	+16	32	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
TMHC	16	01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	
TMHA	48	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	
TMHE	64	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	
TMHCT	80	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	

※When using TMHC, in case connecting only TMHC to Master (PC, PLC, etc.), communication address of TMHC and TMH2/4 Series control module can be duplicated. However, in case connecting both TMHC and TMH2/4 Series control module to Master, communication address must not be duplicated. (If the TMHC and TMH modules communicate to Master at the same time, a communication error may occur.)

### ◎ Caution for communication address setting

After changing communication address via the power/comm. terminal, reboot the device.

# Multi-Channel Modular Type High Performance

## ■ Proper Usage

### ◎ Cautions during use

- Follow instructions in 'Cautions during Use'. Otherwise, It may cause unexpected accidents.
- Check the polarity of the terminals before wiring the temperature sensor.  
For RTD temperature sensor, wire it as 3-wire type, using cables in same thickness and length.  
For thermocouple (CT) temperature sensor, use the designated compensation wire for extending wire.
- Keep away from high voltage lines or power lines to prevent inductive noise.  
In case installing power line and input signal line closely, use line filter or varistor at power line and shielded wire at input signal line.  
Do not use near the equipment which generates strong magnetic force or high frequency noise.
- Do not apply excessive power when connecting or disconnecting the connectors of the product.
- Install a power switch or circuit breaker in the easily accessible place for supplying or disconnecting the power.
- Do not use the unit for other purpose (e.g. voltmeter, ammeter), but temperature controller.
- When changing the input sensor, turn off the power first before changing.  
After changing the input sensor, modify the value of the corresponding parameter.
- Power supply should be insulated and limited voltage/current or Class 2, SELV power supply device.
- Do not overlapping communication line and power line.  
Use twisted pair wire for communication line and connect ferrite bead at each end of line to reduce the effect of external noise.
- Make a required space around the unit for radiation of heat.  
For accurate temperature measurement, warm up the unit over 20 min after turning on the power.
- Make sure that power supply voltage reaches to the rated voltage within 2 sec after supplying power.
- Do not wire to terminals which are not used.
- Install DIN rail vertically from the ground.
- This unit may be used in the following environments.
  - ① Indoors (in the environment condition rated in 'Specifications')
  - ② Altitude max. 2,000m
  - ③ Pollution degree 2
  - ④ Installation category II

(A)  
Photoelectric  
Sensors

(B)  
Fiber  
Optic  
Sensors

(C)  
Door/Area  
Sensors

(D)  
Proximity  
Sensors

(E)  
Pressure  
Sensors

(F)  
Rotary  
Encoders

(G)  
Connectors/  
Connector Cables/  
Sensor Distribution  
Boxes/Sockets

(H)  
Temperature  
Controllers

(I)  
SSRs / Power  
Controllers

(J)  
Counters

(K)  
Timers

(L)  
Panel  
Meters

(M)  
Tacho /  
Speed / Pulse  
Meters

(N)  
Display  
Units

(O)  
Sensor  
Controllers

(P)  
Switching  
Mode Power  
Supplies

(Q)  
Stepper Motors  
& Drivers  
& Controllers

(R)  
Graphic/  
Logic  
Panels

(S)  
Field  
Network  
Devices

(T)  
Software